


DRAWING NUMBER
A-105
Cantor Fitzgerald
E-4

DRAWING NUMBER
PLAN HEAD CORPORATION • IRVINE, CALIFORNIA
RENDERED BY NUMBER OTHER
PAGES ARE IN FILE 28, 29, 30, 31

DRAWING NUMBER
PLAN HEAD CORPORATION • IRVINE, CALIFORNIA
RENDERED BY NUMBER OTHER
PAGES ARE IN FILE 28, 29, 30, 31

DRAWING NUMBER
PLAN HEAD CORPORATION • IRVINE, CALIFORNIA
RENDERED BY NUMBER OTHER
PAGES ARE IN FILE 28, 29, 30, 31

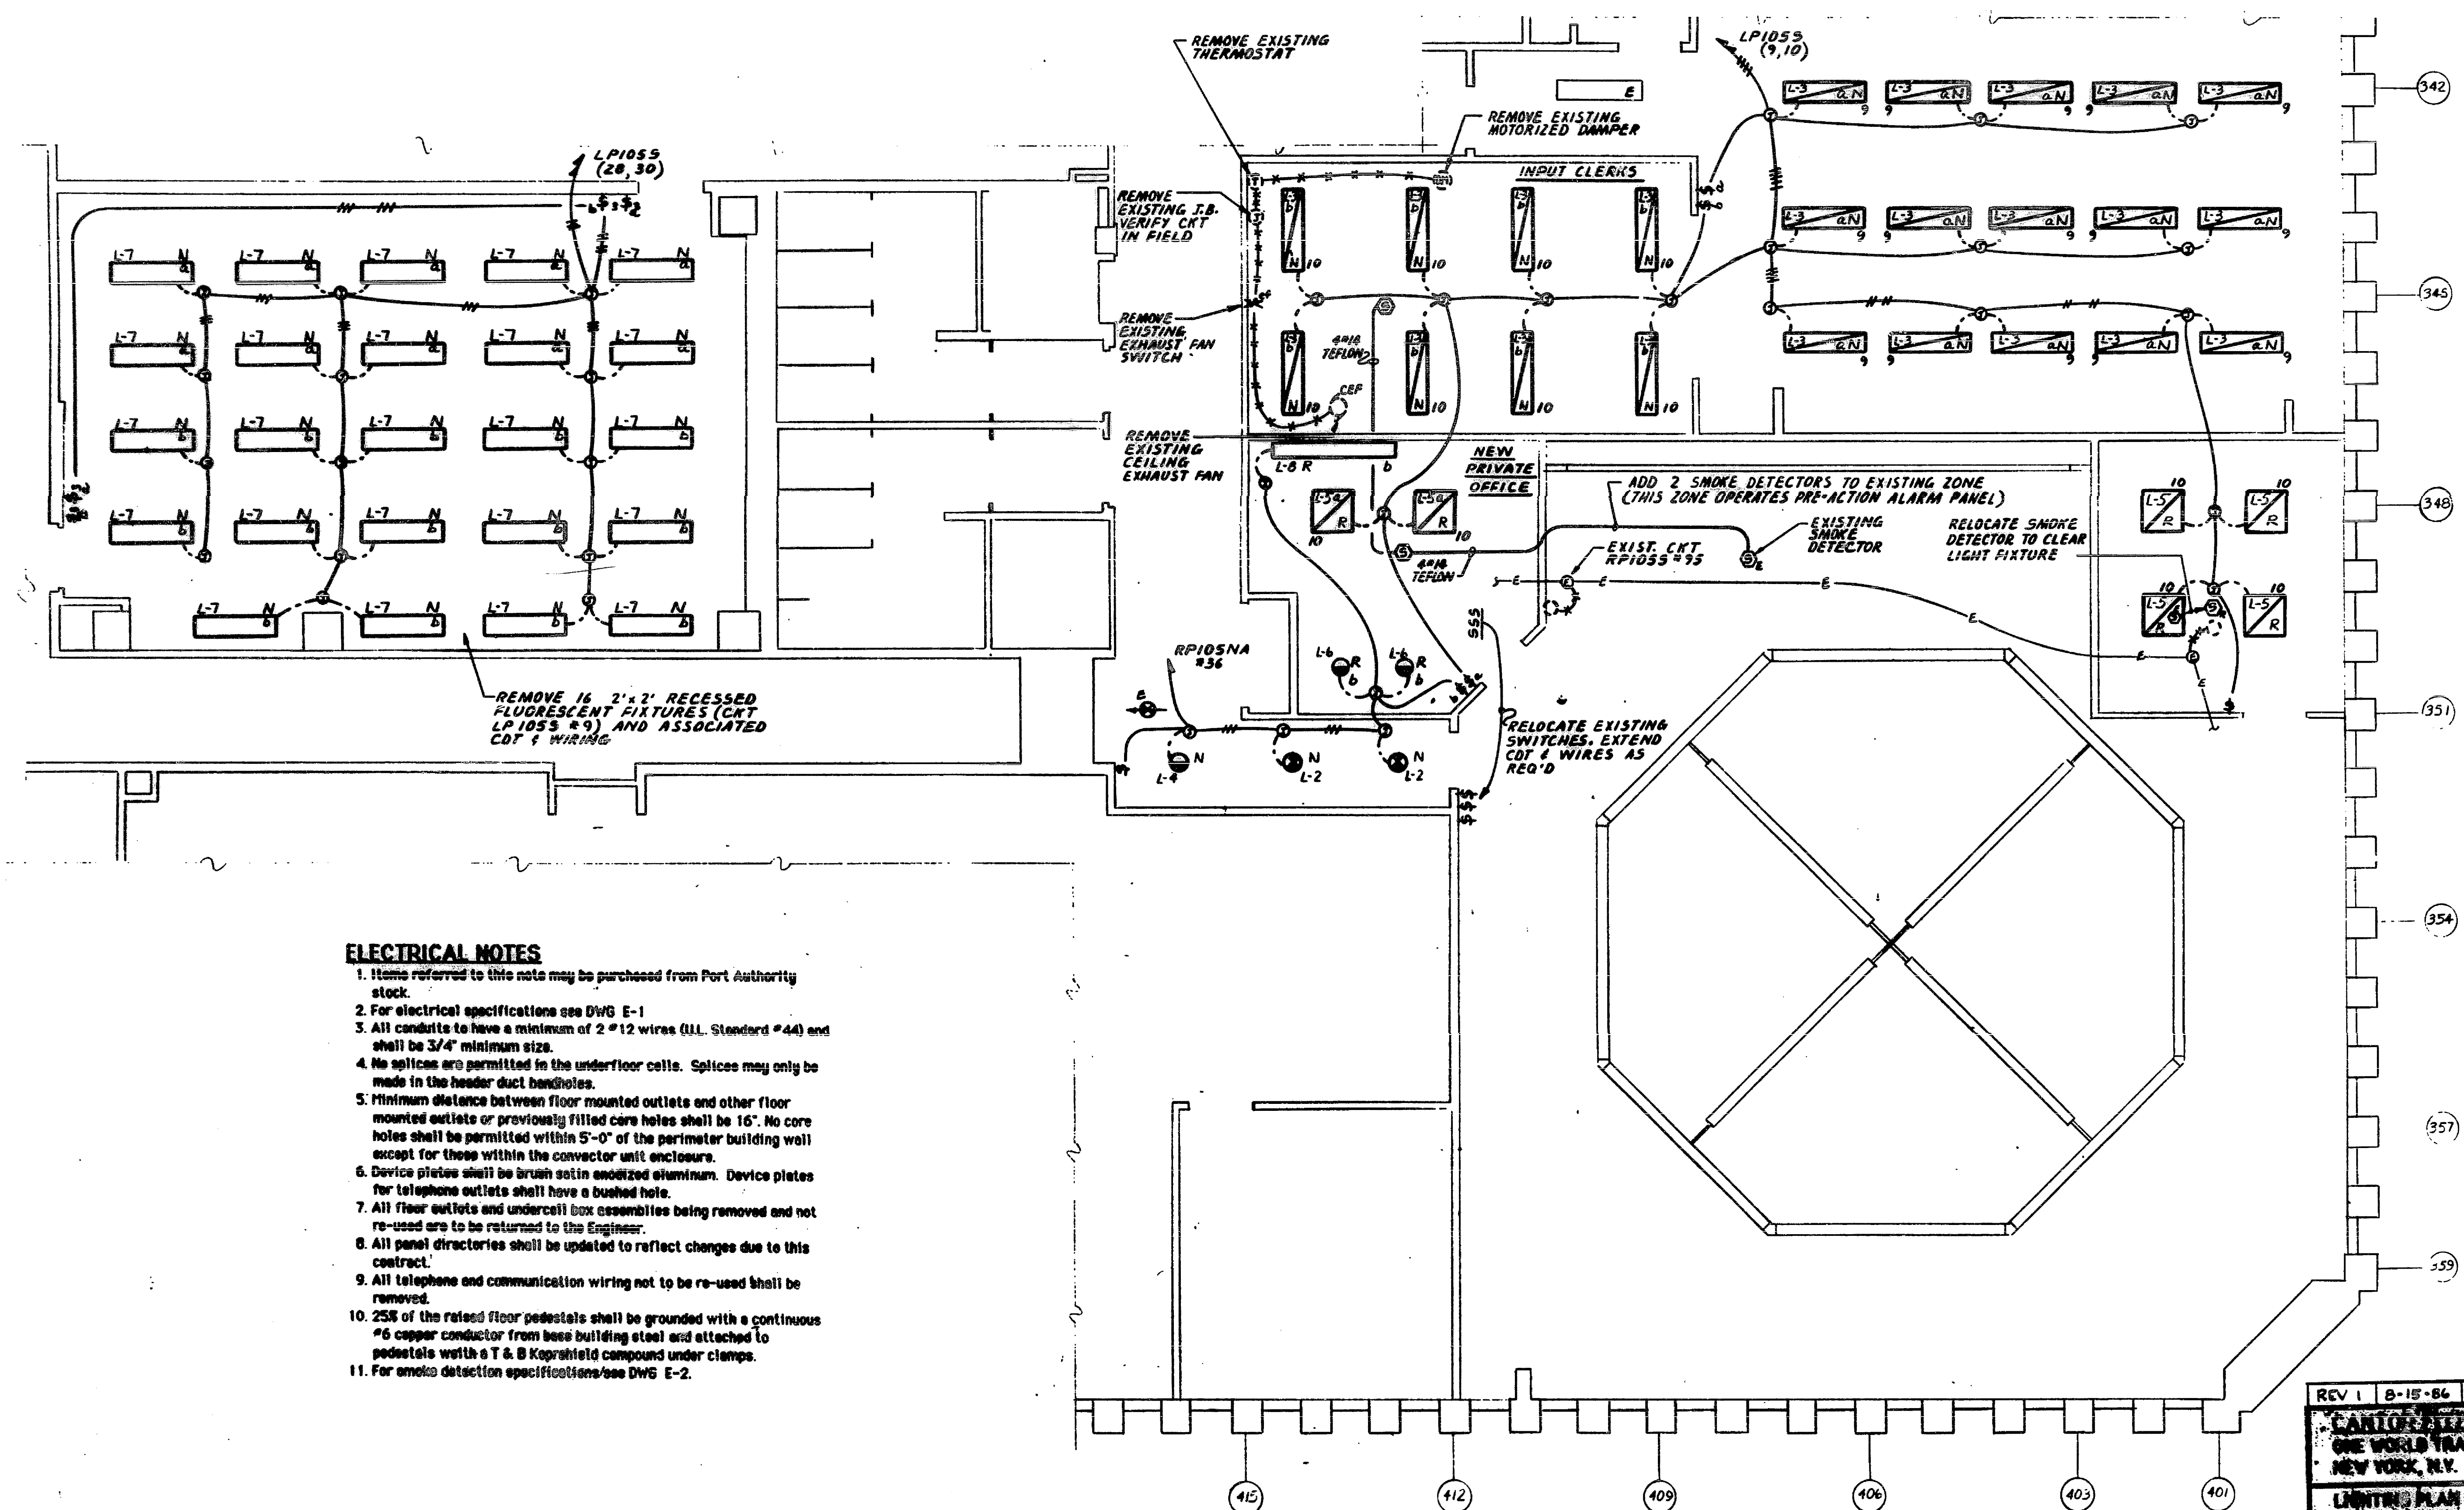

- ELECTRICAL NOTES**
1. Items referred to this note may be purchased from Port Authority stock.
 2. For electrical specifications see DWG E-1
 3. All conduits to have a minimum of 2 #12 wires (U.L. Standard #44) and shall be 3/4" minimum size.
 4. No splices are permitted in the underfloor cells. Splices may only be made in the header duct bankholes.
 5. Minimum distance between floor mounted outlets and other floor mounted outlets or previously filled core holes shall be 16". No core holes shall be permitted within 5'-0" of the perimeter building wall except for those within the convactor unit enclosure.
 6. Device plates shall be brush satin enameled aluminum. Device plates for telephone outlets shall have a bushed hole.
 7. All floor outlets and undercell box assemblies being removed and not re-used are to be returned to the Engineer.
 8. All panel directories shall be updated to reflect changes due to this contract.
 9. All telephone and communication wiring not to be re-used shall be removed.
 10. 25% of the raised floor pedestals shall be grounded with a continuous #6 copper conductor from base building steel and attached to pedestals with a T & B Koprashield compound under clamps.
 11. For smoke detection specifications see DWG E-2.

REV 1 8-15-84 AS PER PORT AUTHORITY COMMENTS

CANTOR FITZGERALD SECURITIES CORP.
ONE WORLD TRADE CENTER-FLOOR 105
NEW YORK, N.Y. 10048

LIGHTING PLAN SOUTH 3

JOHN C. WESTRICK & ASSOCIATES
CONSULTING ENGINEERS
2110 MAPLE AVENUE
SOUTH PLAINFIELD, N.J. 07080

SCALE: 1/4" = 1'-0" DOWN BY: JWN CHK BY: JWN
DATE: 6-2-84 JOB NO: 84-13

NEW YORK STATE
JULY 1984
054052
PROFESSIONAL ENGINEER